


[Print This Out](#)[Go Back](#)

**Mini Corodek®**  
Continuous sinusoidal wall cladding

## Specification


### REFERENCED AUSTRALIAN STANDARDS

AS 1170.2	SAA Loading Code - Wind Loads.
AS 1397	Sheet and Strip Hot-Dripped Zinc-Coated or Aluminium/Zinc Coated.
AS 1445	Hot-Dipped Zinc-Coated or Aluminium/Zinc Coated Steel Sheet - 76mm pitch corrugated.
AS 1526	One part polysulphide-based Sealing Compounds for the Building Industry.
AS 1562.1	Design and installation of Steel Roof and Wall Cladding. Part 1: Metal.
AS 2179	Rainwater Goods - Specification.
AS 2180	Rainwater Goods - Design and Installation.
AS 2728	Pre Painted and Organic Film/Laminate Products - Performance Requirements for Interior & Exterior Applications in Buildings
AS 3566	Screws Self-Drilling for the Building and Construction Industries.

## Scope

Where indicated on the drawings, provide and fix continuous sinusoidal sheet roof and/or wall cladding all as specified herein complete with all necessary fasteners, accessories, trims and flashings. All such work shall be in accordance with AS 1562.1, AS 2179, AS 2180 and AS 3566.

## Materials

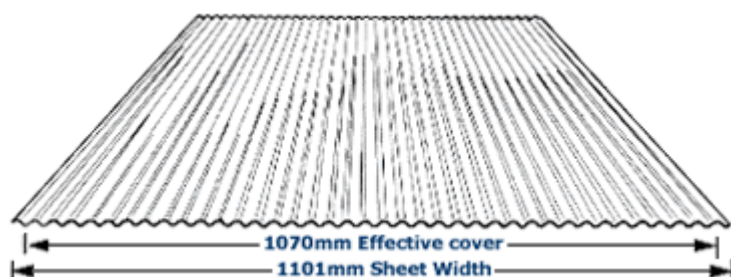

### ROOFING (AND/OR WALLING)

Roofing (and/or walling) shall be Mini Corodek 25mm pitch continuous sinusoidal sheet wall cladding as described below.

Number of Ribs:	1 Underlap, 1 Overlap, 4 Internal
Rib Height:	6mm
Cover Width:	1070mm Total Width; 1101mm
Base Metal Thickness:	0.40mm
Approximate total coated thickness:	0.45mm

Steel base description:	AS 1397-G550 (550MPa minimum yield strength)
Metallic coating description:	AS 1397-AZ 150 (150g/sq. m minimum coating mass)
Organic coatings (if used):	To AS 2728
Normal Environments:	Colorbond XRW
Severe Environments:	Colorbond ULTRA

## Fastener Selection

	Fixing to Steel Batten Material 0.42 to 1.0mm	Fixing to Cold Formed Steel Purlin and Girt Material 1.2mm BMT to 4.5mm	Fixing to Hot Rolled Steel Purlin and Girt Material 4.5mm to 6.4mm (Non-Stocked Items)
<b>Crest Fixed</b>	SPS 8-18 X 12mm Pan Hd. Self Drilling Screws	SPS 8-18 X 12mm Pan Hd. Self Drilling Tapping Screws	TPS 8-15 x 20mm Pan Hd. Self Drilling Screws
<b>Valley Fixed</b>	4.8mm Aluminium Sealed Blind Rivet	4.8mm Aluminium Sealed Blind Rivet	
<b>Side Lap &amp; Accessories</b>	3.2 Aluminium Sealed Blind Rivet		

## Notes

1. Coating of fasteners shall comply with AS 3566 class 3 for exterior applications. XRW - Climaseal, ULTRA - ZAC or 40 Microns Zinc, Colorbond Stainless - Stainless Steel.
2. Add a minimum on 10mm to the nominated fastener length, when fixing over insulation blanket.
3. All fasteners exposed to the weather shall be fitted with sealing washers to comply with ASTM. D 2000.
4. Any selection made from this table is to be checked against the latest version of BHP Coated Steel Australia Technical Bulletin TB-16, to ensure that the finish is appropriate for the service conditions.
5. Climaseal, HiGrip®, Shank Guard and ZAC are registered trademarks of ITW Buildex.

## Workmanship

### CARE STORAGE AND HANDLING:

Packs of sheets shall be kept dry in transit and on site to prevent water and or condensation being trapped between adjacent surfaces. Packs shall be safely and neatly stacked on site, clear of the ground and protected from the rain and moisture. Any sheets which become wet shall be separated, wiped clean, dried and re-stacked in a manner to allow free air circulation.

### CUTTING:

Sheets shall be cut in a manner, and in a location, such that damage is avoided both to the subject sheet and to other nearby finished building products.

## Installation

Sheets shall be laid with correct overlaps on battens or purlins spaced at centres not exceeding the manufacturer's maximum recommended span for the specific conditions pertaining at the

site of the works, as determined by the building designer. Wherever practicable roof runs shall be covered with single-length sheets from crest to gutter. End laps and/or expansion joints shall be provided in longer roofs at the spacings, and the details set down by the manufacturer's installation manual, and purlin/batten spacings positions adjusted accordingly.

Sheets shall be handled carefully, in the interests of occupational health and safety and to avoid damage to nearby finished building products. Where sheets and/or accessories are provided with stripable plastic coatings, such material shall be removed at time of installation and be disposed of in a responsible manner. Fix sheeting with appropriate fasteners (from table herein) in all respects in accordance with the instructions given in the manufacturer's installation manual.

Turn high ends of sheets up, and gutter ends down to the extent, and using the tool, specified in the manufacturer's installation manual. All flashings, trims and closures to adjoining work shall be made from matching material, or from other approved compatible material and shall be formed, notched and fitted so as to present an effective, neat and workmanlike finished job. Where necessary, flashings shall be lapped and sealed at joints in accordance with the manufacturer's installation manual.

At the conclusion of each day's work, and at the completion of the roofing contract, roof all areas shall be swept clean, ensuring that all metal swarf and other debris is removed. A close inspection shall follow to make certain that no small, heavy items (eg. Unused fasteners or mandrels of concealed-fastening rivets) are lodged in places from which coating damage could be initiated.

---